



ROOTY HILL REGIONAL DISTRIBUTION CENTRE MONTHLY ENVIRONMENTAL MONITORING REPORT						
Aspect	ect Air Quality, Construction Noise and Meteorology					
Date	April 2014					
SUMMARY						
Monitoring period		1 April to 30 April				
Parameters monitored in period		Dust (PM <sub>10</sub> ) / TSP Depositional Dust Construction Noise Local Meteorology				
Exceedance summary		<ul> <li>No exceedances of PM<sub>10</sub> or TSP dust criteria were recorded during April 2014.</li> <li>No exceedances of depositional dust criteria were recorded during April 2014.</li> <li>No exceedances of the construction noise management levels were recorded in April 2014.</li> </ul>				
Action required		None				

# 1. Monitoring Locations

The monitoring locations at the Rooty Hill Regional Distribution Centre (RDC) for air quality, construction noise and meteorology are shown in Figure 1 and consist of:

- Dust monitoring (PM<sub>10</sub>): Blacktown International Sportspark (formally Olympic Park)
- Dust monitoring (Depositional): Locations 1 to 3
- Noise monitoring: Locations 2 to 5
- Meteorology: Blacktown International Sportspark (formally Olympic Park)



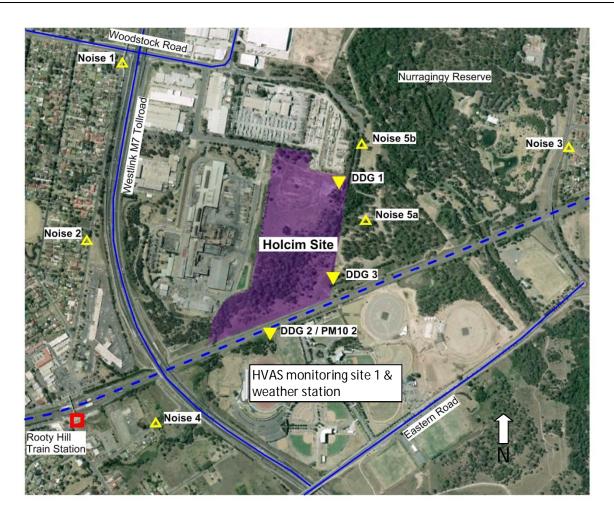


Figure 1 Monitoring locations

# 2. Monitoring Methodology

## Dust

Air quality (dust) monitoring was undertaken using an Ecotech High Volume Air Sampler (HVAS) 3000 with a Particulate Matter -  $10\mu$ m (PM<sub>10</sub>) sampling head. The HVAS was operated on one-day-in-six in accordance with *AS/NZS 3580.9.6:2003 Methods for sampling and analysis or ambient air, Method 9.6: Determination of suspended particulate matter (PM10) – High volume sampler with size selective inlet - Gravimetric method.* 

Calibration of the unit is checked on a monthly basis, in accordance with operating instructions for the unit and *AS/NZS 3580.9.6:2003*.

TSP will not be directly monitored, and instead will be calculated by application of a conversion factor (PM10 x 2.5 = TSP), in accordance with the site Operational Monitoring Plan.

Depositional dust was monitored in accordance with *AS/NZS 3580.10.1:2003 Methods for sampling and analysis of ambient air Method 10.1: Determination of particulate matter – Deposited matter – Gravimetric method.* 

## **Construction Noise**

Construction noise was monitored for 15 minute attended periods in accordance with the requirements set out in the EPA (2000) Industrial Noise Policy and the DECC (2009) Interim Construction Noise Guidelines (ICNG). Monitoring was carried out using a SVAN 858 Type 1 Sound Level Meter by appropriately qualified personnel. Calibration of the unit was checked before and after each monitoring period, and the drift was below 0.5dB.

# Local Meteorology

Meteorological conditions were monitored using a Davis Vantage Pro2 Plus monitoring unit. This unit was positioned in accordance with *AS2923-1987 Ambient air – Guide for measurement of horizontal wind for air quality applications.* 

The Davis Vantage Pro2 plus meteorological station does not satisfy the accuracy requirements of AS 3580.14-2011 for wind speed and direction measurements. However, no monitoring standards are specified in the Project Approval and the accuracy of the proposed unit is considered sufficient for the purposes of construction impact management.

The integrity of the meteorological monitoring station is checked every six days.

3. Guidelines

## Air Quality

Air quality (dust) criteria within the Project Conditions of Approval, specifically Statement of Commitment (SoC) 4.1 and the Construction Dust Management Plan (CDMP) mirror those in the NSW EPA document *Approved methods for the modelling and assessment of air pollutants in New South Wales* (DEC 2005). The air quality assessment criteria are outlined in Table 1, which apply cumulatively (that is, due to all sources of emissions and not just the contribution from the project).

## Table 1 Air Quality Criteria

Pollutant	Averaging period	Concentration		
PM <sub>10</sub>	24 hours	50ug/m <sup>3</sup>		
	Annual	30ug/m <sup>3</sup>		
TSP	Annual	90ug/m <sup>3</sup>		
Deposited dust	Annual	4 g/m <sup>2</sup> /month*		

\* Depositional dust criteria contained in the NSW EPA methods specify a maximum contribution of 2g/m<sup>2</sup>/month, up to a maximum total depositional dust level of 4g/m<sup>2</sup>/month. This criterion assumes a typical existing load of 2g/m<sup>2</sup>/month, prior to the start of construction activities.

TSP will not be directly monitored, and instead will be calculated by application of a conversion factor  $(PM_{10} \times 2.5 = TSP)$ , in accordance with the site Operational Environmental Monitoring Plan.



#### **Construction Noise**

The Noise Management Levels (NML) for construction of the Rooty Hill RDC are provided in Table 2. These are based on the requirements of the ICNG, Ministers Condition of Approval (MCoA) 2.2 and the measured background levels.

## Table 2 Construction Noise Management Levels

Receiver		Receiver Type	Approximate Distance and Orientation from RDC boundary	NML LAeq,15min / dB(A)
1	132 Station Street	Residential	650m west	58
2	54 Station Street	Residential	650m west	58
3	63 Coghlan Street	Residential	850m east	58
4	16 Mavis Street	Residential	650m west	63
5a	Lomandra Shelter Shed (Nurragingy Reserve)	Recreational	<100m east	60
5b	Boronia Shelter Shed (Nurragingy Reserve)	Recreational	<100m east	60

A construction noise impact assessment undertaken for the Construction Noise Management Plan (CNMP) predicts no exceedance of the NMLs at residential receivers throughout the construction program. Within the reserve, occasional exceedances are anticipated such as during earthworks; vegetation clearing; and installation of building structures and equipment.

Previous monthly monitoring reports have assessed compliance with MCoA 2.3. SKM has completed a detailed review of this MCoA alongside the CNMP approved under MCoA 5.3(b) and concluded that MCoA 2.3 is related to the operational phase and does not need to be assessed from a compliance perspective during the construction phase. The NMLs and noise predictions in the CNMP are a more accurate indication of the likely impacts from Stage 2 construction works.

## Meteorology

SoC 3.3, 10.4 and 15.3 requires Holcim monitor local meteorological conditions at the site. To comply with the SoC the following parameters must be monitored:

- Daily air temperature
- Solar radiation
- Daylight hours
- Daily rainfall
- Daily evaporation
- Continuous wind speed and direction



## 4. Monitoring results

Air Quality

PM<sub>10</sub> / TSP

No exceedances of PM<sub>10</sub> or TSP dust criteria were recorded during the month of April 2014.

#### Table 3 April PM<sub>10</sub> and TSP Results

	PM <sub>10</sub> (	ug/m³)	TSP		
Date	Measured result	Criteria	Calculated result (PM10 x 2.5)	Criteria	
3/04/2014	-*	50	-*	NA	
9/04/2014	-*	50	-*	NA	
15/04/2014	-*	50	-*	NA	
21/04/2014	-*	50	-*	NA	
29/04/2014	25.2	50	63.0	NA	
Annual average (to date)	22.8		57.0		

\*Unit out of order, electrical fault corrected by Holcim.

#### Depositional Dust

No exceedances of depositional dust criteria were recorded during the month of April 2014.

## Table 4 Depositional Dust Gauge Results April 2014

Total Insolu	Goal				
Location	1	2	3	(annual average)	
2/04/2014 - 29/04/2014	2.6	1	0.9	N/A	
Annual average	2.5	2.0	2.1	4 g /m <sup>2</sup> /month	

\*\* Average does not include erroneous result obtained on 31/10/2013.

#### Construction Noise

No exceedances of construction noise management levels were observed during April 2014.

Small scale earthworks were being carried out in the northern and southern areas of the site. Audible noise included truck movements between the two work areas, and earthmoving equipment in the south.

The results of attended construction noise monitoring are presented in Table 5.

# Table 5 Construction Noise Monitoring Results


Location	Start	Construction contribution L <sub>Aeq</sub>	L <sub>Aeq</sub>	L <sub>A10</sub>	L <sub>A90</sub>	NML L <sub>Aeq,15</sub> <sub>min</sub> / dB(A)	Notes
1 (132 Station St)	9:05	IA	56	59	52	58	Holcim inaudible, M7 (constant 60-65), birds, pedestrians.
2 (54 Station St)	9:25	IA	57	59	52	58	Holcim inaudible, M7 (constant 55-60), local traffic (55 - 65), birds, reversing beepers from OneSteel
3 (63 Coghlan St)	10:45	IA	58	61	50	58	Holcim inaudible, trains, Knox Rd traffic (constant 55-65).
4 (16 Mavis St)	10:20	IA	54	56	58	63	Holcim inaudible, M7 (constant 55-60), birds, aeroplane, trains.
5a (Lomandra Shelter Shed [Nurragingy Reserve])	8:10	30	56	58	55	60	Holcim (occasional reversing alarms and trucks 55), birds, local traffic, aeroplane, train.
5b (Boronia Shelter Shed [Nurragingy Reserve])	8:40	40-50	57	59	52	60	Holcim (occasional light vehicles and banging 55-65, constant engine noise 45- 50), birds, local traffic.

\*IA - Inaudible

## Local Meteorology

A wind rose showing the proportion of direction and strength of winds throughout the reporting period is below. A complete data set, including, humidity, temperature and rainfall is provided separately.

The wind rose shows that winds were generally light, with areas to the north and north west of the site were the most likely to be impacted by construction generated dust. This area includes the industrial areas on Kellogg Road.

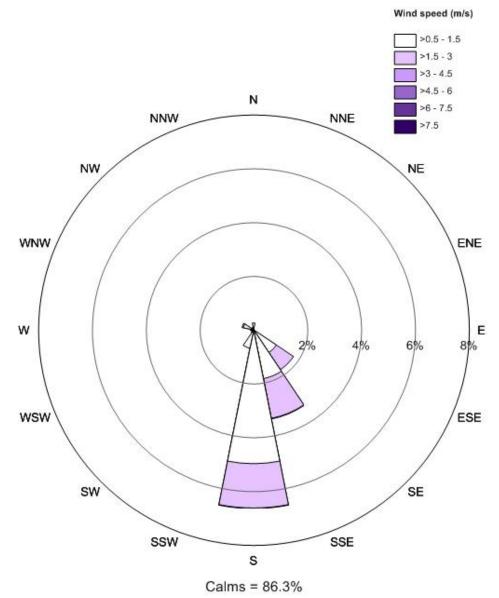

Windrose for April 2014